

5. AS A GENERAL GUIDE, THE MINIMUM CLEARANCE REQUIRED FROM ANY OBSTRUCTION IS 6 FEET.
4. PROVIDE A CLEAR VERTICAL EXHAUST FIELD. REVIEW MANUAL FOR DETAILED INSTALLATION AND SITE CONDITIONS.
3. MAXIMUM INTAKE AIR TEMPERATURE IS 120°F. INTAKE AIR IS DRAWN IN FROM SIDES, END AND BOTTOM OF UNIT.
2. ALL DIMENSIONS ARE APPROX. IN INCHES [mm]
1. WEIGHT: 1500 LBS APPROX [680 Kg]




PERMANENT LOAD BANK - SINGLE BAY UNIT  
GENERAL REFERENCE OUTLINE DRAWING


Model 4810

1 OF 2


Rev. K

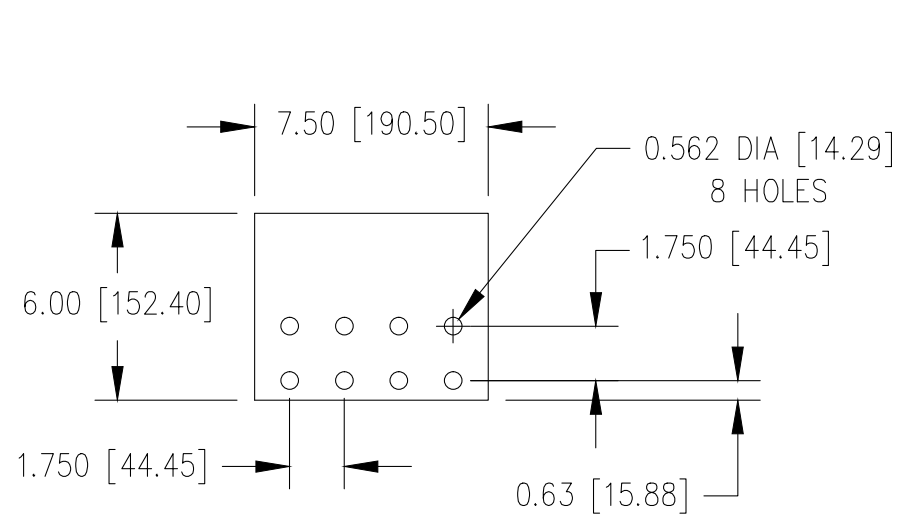

LOAD CONNECTION BUS BAR DETAIL  
 BUS BARS ARE 0.25 [6.35] THICK  
 TIN PLATED COPPER  
 TYPICAL FOR ALL THREE PHASES  
 (SCALE: NONE)

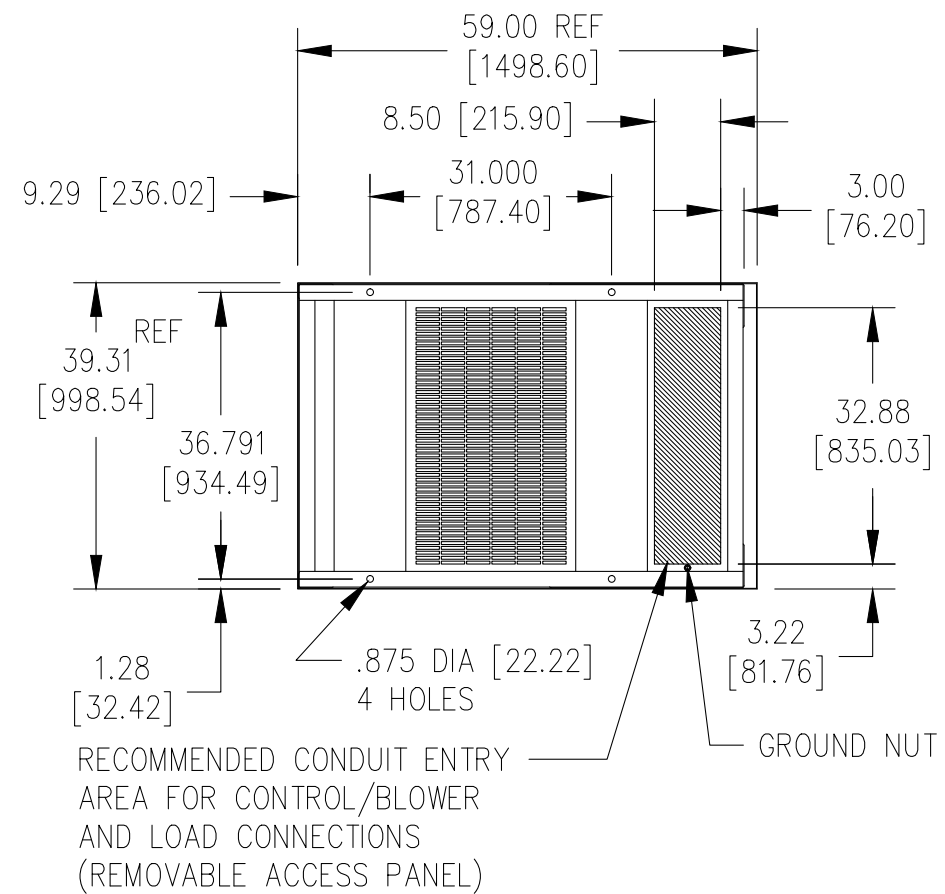

VIEW A-A

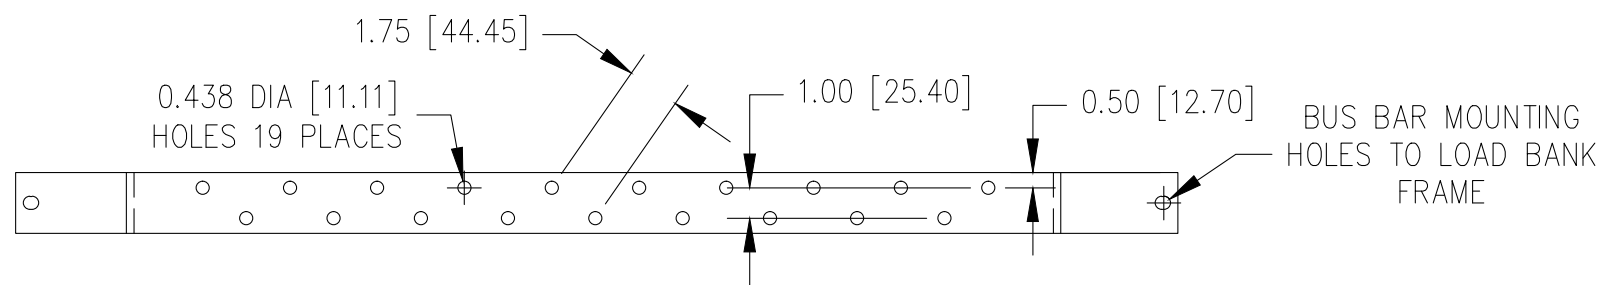

GROUND BUS BAR DETAIL  
 GROUND BUS BAR IS  
 0.25 [6.35] THICK COPPER  
 (SCALE: NONE)