

5. AS A GENERAL GUIDE, THE MINIMUM CLEARANCE REQUIRED FROM ANY OBSTRUCTION IS 6 FEET.
4. PROVIDE A CLEAR VERTICAL EXHAUST FIELD. REVIEW MANUAL FOR DETAILED INSTALLATION
3. MAXIMUM INTAKE AIR TEMPERATURE IS 120°F. INTAKE AIR IS DRAWN IN FROM SIDES AND REAR OF UNIT.
2. ALL DIMENSIONS ARE APPROX. IN INCHES [mm]
1. WEIGHT: 3000 LBS APPROX [1361 Kg]




PERMANENT LOAD BANK - TWO BAY UNIT
 GENERAL REFERENCE OUTLINE DRAWING


Model 4820 1 OF 2 Rev. H

WHEN METERING OPTION SUPPLIED,
CURRENT TRANSFORMERS MOUNTED
THIS SIDE. THESE CAN BE FIELD
RELOCATED TO OTHER SIDE.

RECOMMENDED CONDUIT ENTRY
AREA FOR CONTROL/BLOWER
AND LOAD CONNECTIONS

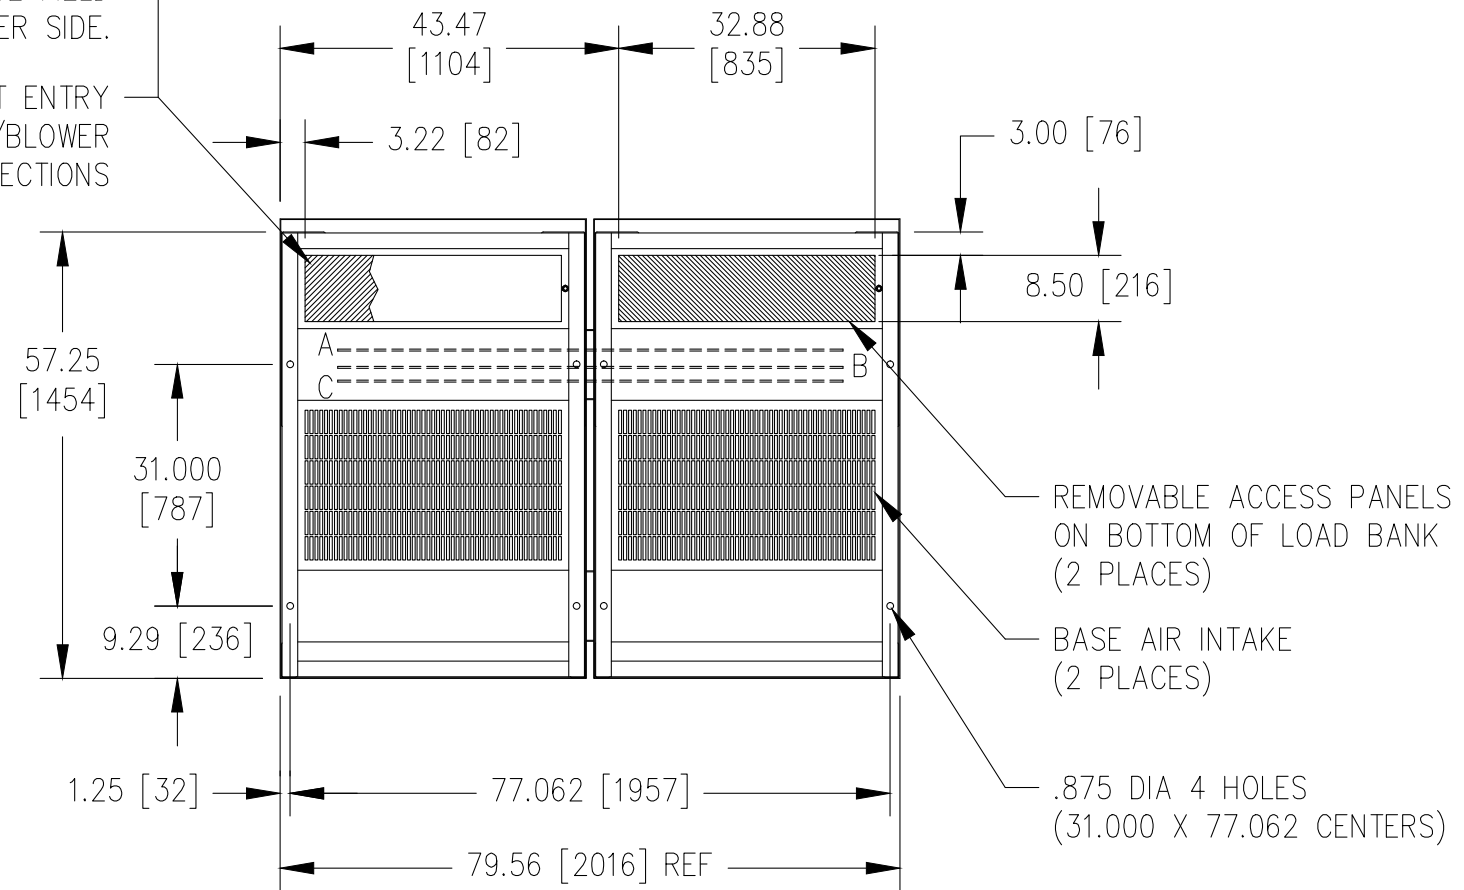

VIEW A—A

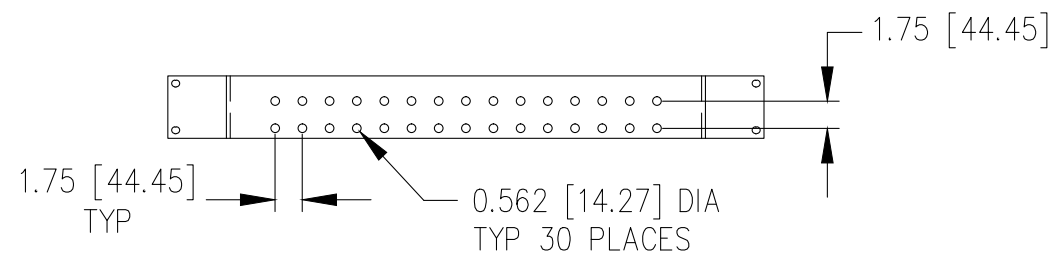

GROUND BUS BAR DETAIL
GROUND BUS BARS IN EACH BAY
GROUND BUS BARS ARE
0.25 [6.35] THICK COPPER