


5. AS A GENERAL GUIDE, THE MINIMUM CLEARANCE REQUIRED FROM ANY OBSTRUCTION IS 6 FEET.
4. PROVIDE A CLEAR VERTICAL EXHAUST FIELD. REVIEW MANUAL FOR DETAILED INSTALLATION AND SITE CONDITIONS.
3. MAXIMUM INTAKE AIR TEMPERATURE IS 120°F. INTAKE AIR IS DRAWN IN FROM SIDES, END AND BOTTOM OF UNIT.
2. ALL DIMENSIONS ARE APPROX. IN INCHES [mm]
1. WEIGHT: 5500 LBS APPROX [2494.76 Kg]

	PERMANENT LOAD BANK - THREE BAY UNIT GENERAL REFERENCE OUTLINE DRAWING	
	Model 4830	1 OF 2
		Rev. N



VIEW A - A

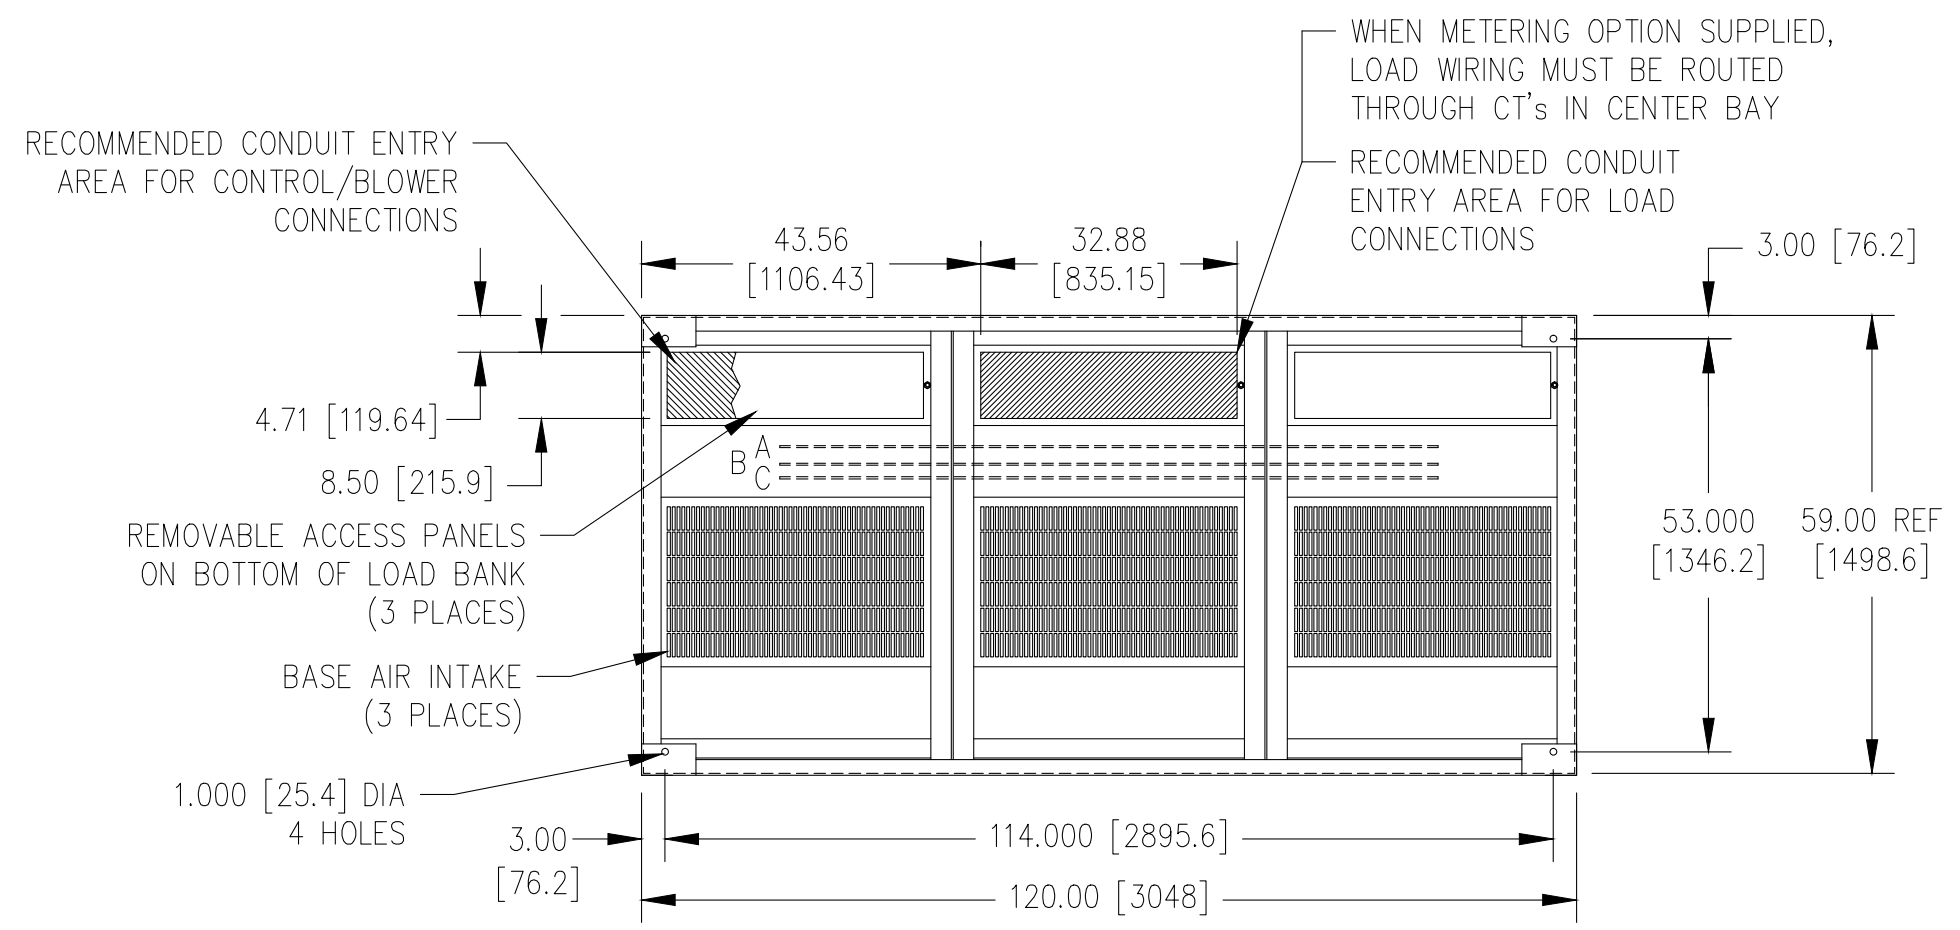