

3. AS A GENERAL GUIDE, THE MINIMUM CLEARANCE REQUIRED FROM ANY OBSTRUCTION IS:
 6 FEET [1829] ON INLET
 3 FEET [914] ON SIDES
 8 FEET [2438] ON EXHAUST
 REVIEW MANUAL FOR DETAILED INSTALLATION AND SITE CONDITIONS.

2. ALL DIMENSIONS ARE APPROX. IN INCHES [mm]

1. WEIGHT: APPROX 3600 LBS [1633 KG]

NOTES:





PERMANENT LOAD BANK
 GENERAL REFERENCE OUTLINE DRAWING

Model 4900

1 OF 2

Rev. H

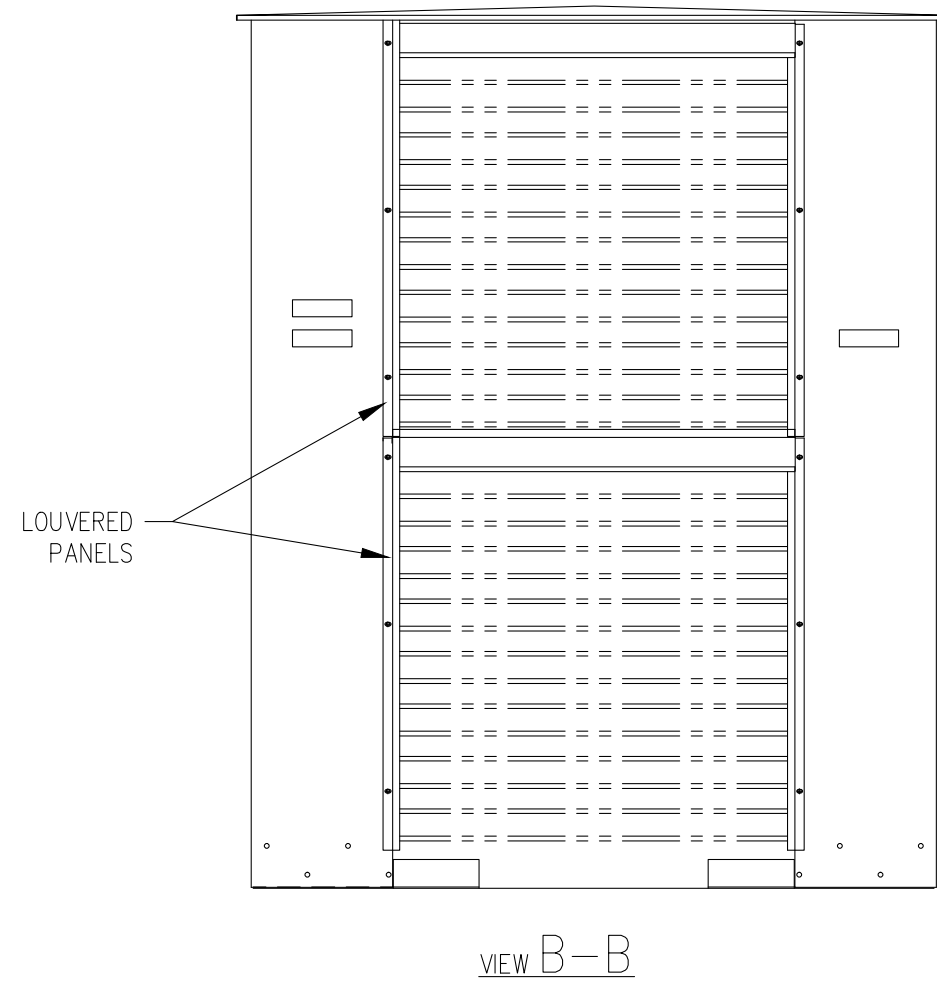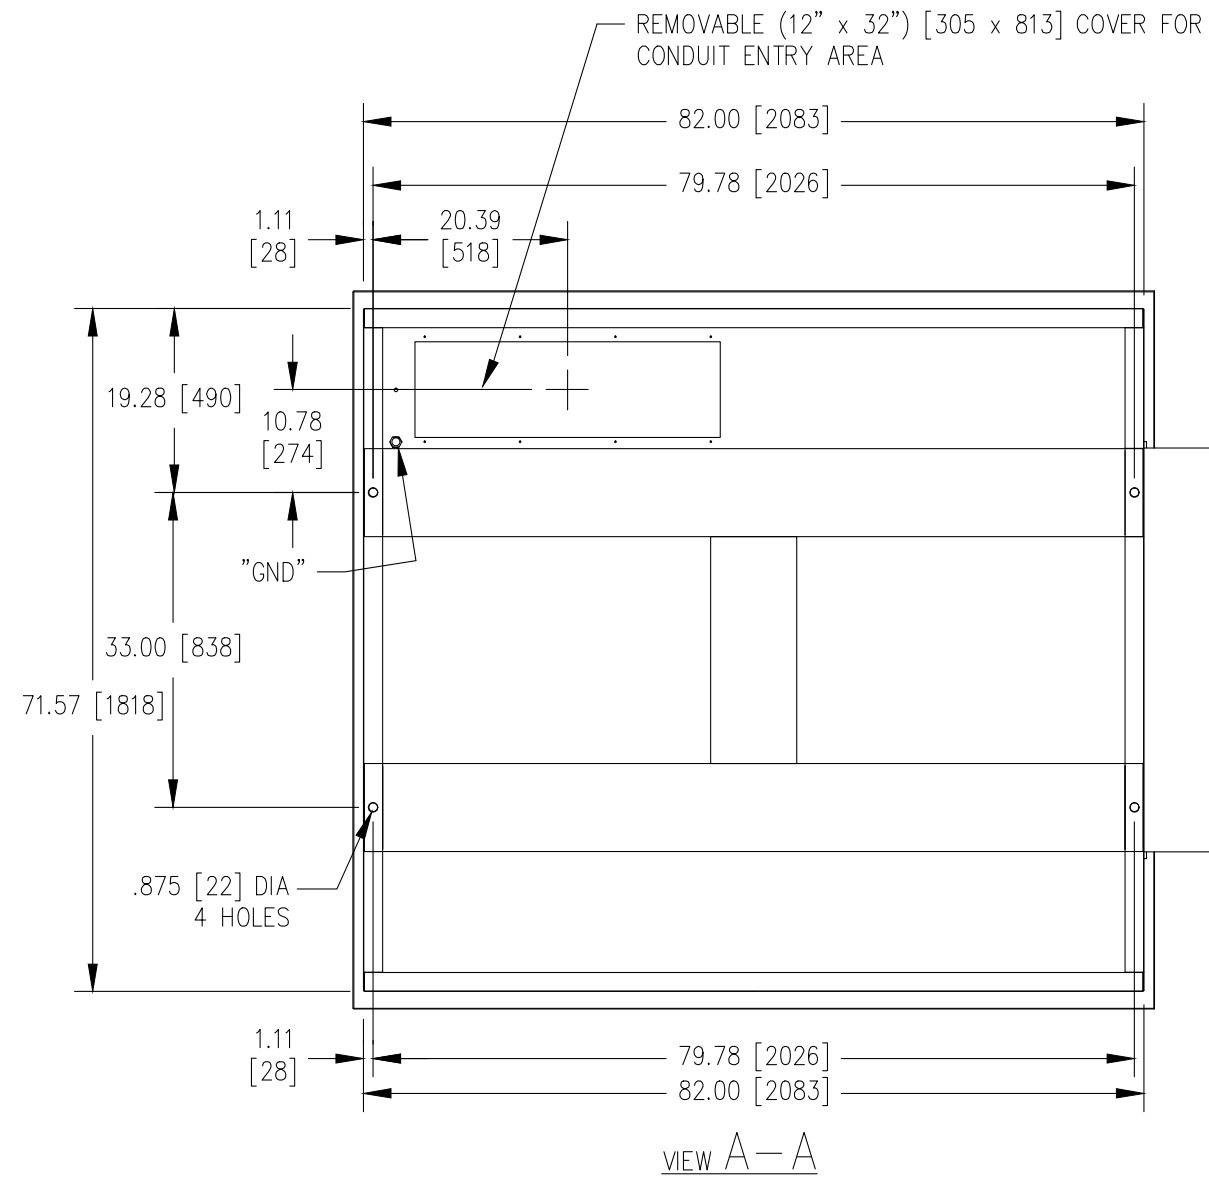

NOTES:



PERMANENT LOAD BANK
GENERAL REFERENCE OUTLINE DRAWING

Model 4900

2 OF 2

Rev. H